

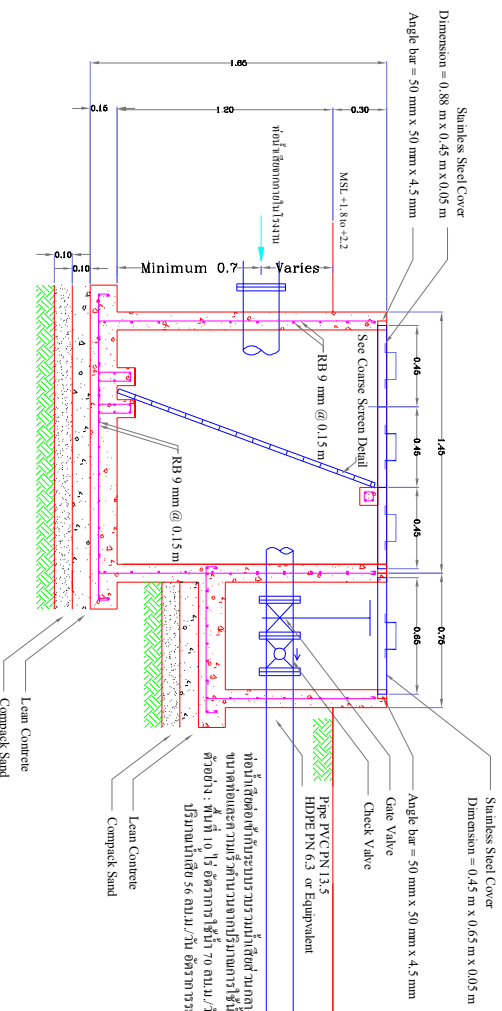


# Factory Area

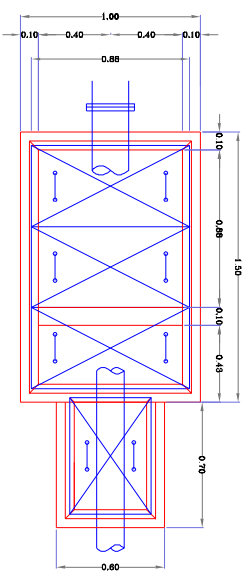


## Sampling Pits and Box Valve ขนาดปลีขนบปลัดตามปริมาณน้ำเสีย

Coarse Screen ( Hot dip Galvanize )  
Dimension = 1.52 m x 0.75 m  
Inlet Strud = 0.100 m x 0.025 m  
Material = Flat Bar Steel : Width 3.2 mm x Thickness 4

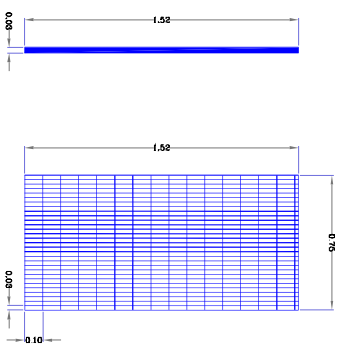

### Coarse Detail

# IEAT Area

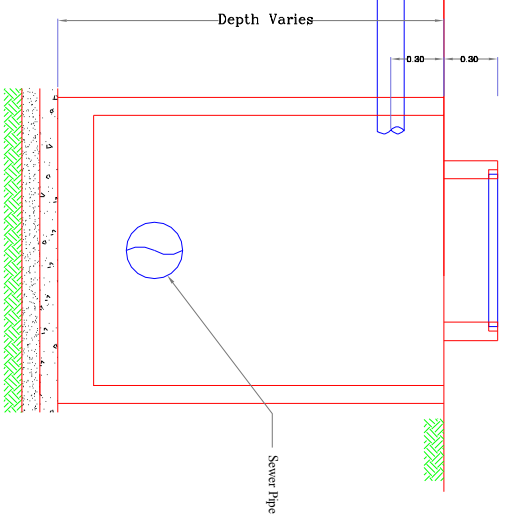

## Sewer Manhole

<b>AMATA WATER CO.,LTD.</b>			
Project : Sampling Pit			
Dwg. Title: Sampling Pit Detail			
Designed by	Approved by	Date	Dwg. No.
		Dec 18, 2014	Sampling Pit